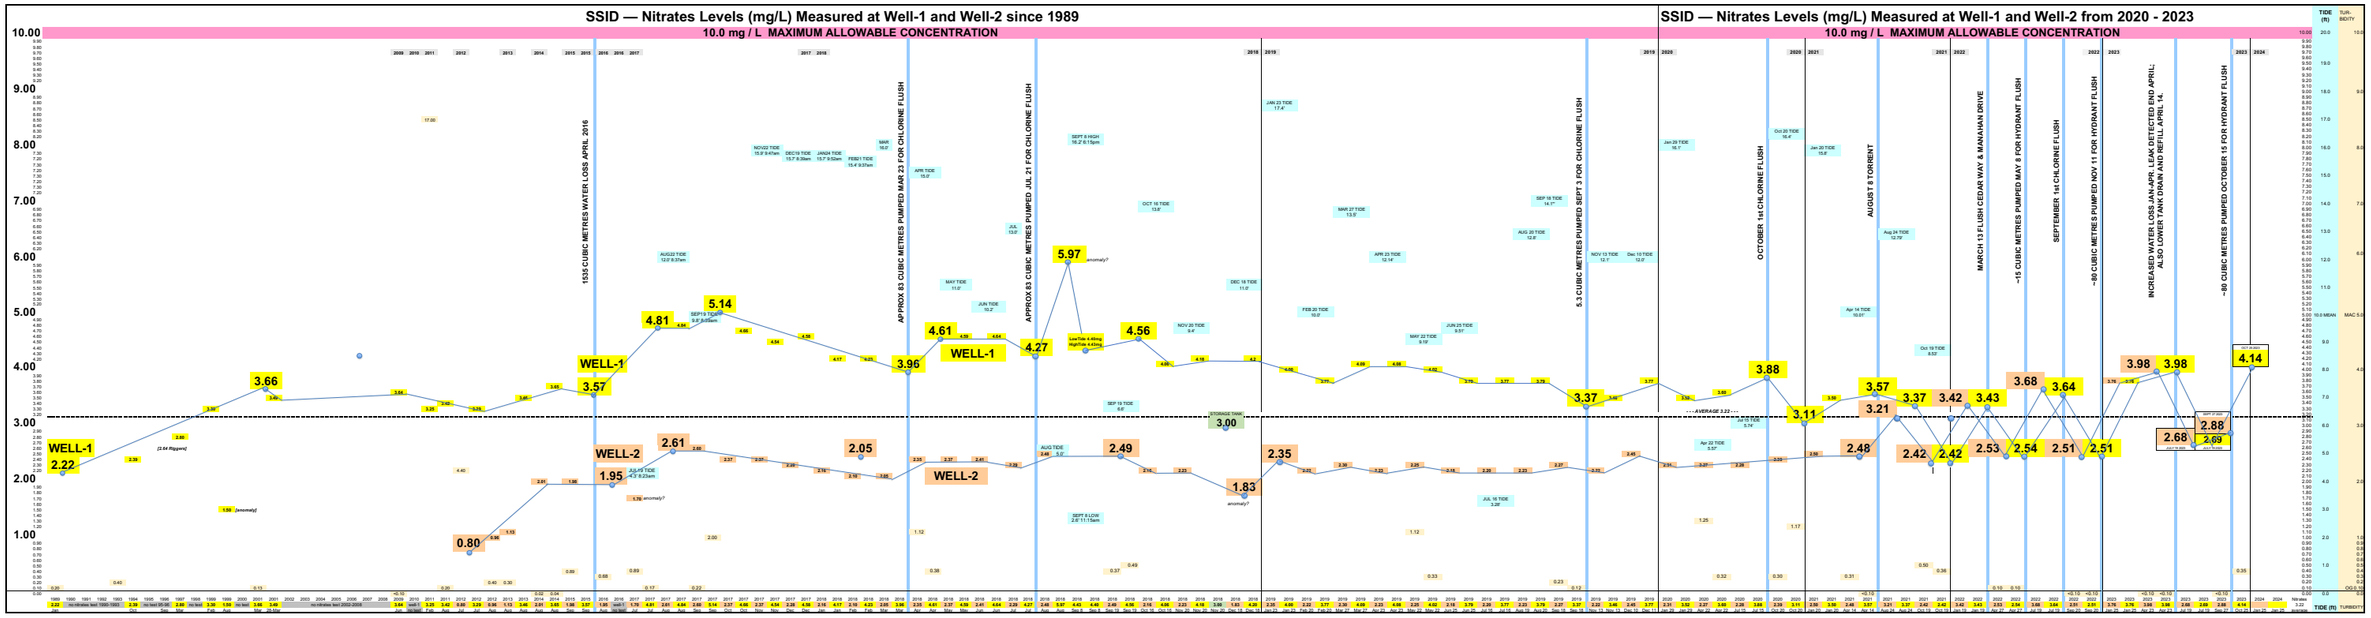
SSID — Nitrates Levels (mg/L) Measured at Well-1 and Well-2 since 1989
10.0 mg / L MAXIMUM ALLOWABLE CONCENTRATION
SSID — Nitrates Levels (mg/L) Measured at Well-1 and Well-2 from 2020 - 2023
10.0 mg / L MAXIMUM ALLOWABLE CONCENTRATION
WELL-1
WELL-2
1535 CUBIC METRES WATER LOSS APRIL 2016
APPROX 83 CUBIC METRES PUMPED MAR 23 FOR CHLORINE FLUSH
APPROX 83 CUBIC METRES PUMPED JUL 21 FOR CHLORINE FLUSH
5.3 CUBIC METRES PUMPED SEPT 3 FOR CHLORINE FLUSH
OCTOBER 1st CHLORINE FLUSH
AUGUST 8 TORRENT
MARCH 13 FLUSH CEDAR WAY & MANAHAN DRIVE
~15 CUBIC METRES PUMPED MAY 8 FOR HYDRANT FLUSH
SEPTEMBER 1st CHLORINE FLUSH
~80 CUBIC METRES PUMPED NOV 11 FOR HYDRANT FLUSH
INCREASED WATER LOSS JAN-APR. LEAK DETECTED END APRIL; ALSO LOWER TANK DRAIN AND REFILL APRIL 14.
~80 CUBIC METRES PUMPED OCTOBER 15 FOR HYDRANT FLUSH
10.00
9.00
8.00
7.00
6.00
5.00
4.00
3.00
2.00
1.00
2.22
3.66
0.80
3.57
1.95
4.81
2.61
5.14
2.05
3.96
4.61
4.27
5.97
2.49
4.56
3.00
1.83
2.35
3.37
3.88
3.11
3.57
3.21
2.48
3.37
3.42
2.42
2.42
3.43
2.53
3.68
2.54
3.64
2.51
2.51
3.98
3.98
2.68
2.88
2.69
4.14